

**National Exam**

**Civ-B5, WATER SUPPLY AND WASTEWATER TREATMENT**

**May 2003**

**Duration - 3 Hours**

**NOTES:**

1. If doubt exists as to the interpretation of any question, the candidate is urged to submit with the answer paper, a clear statement of any assumptions made.
2. This is closed book exam; a formula sheet and necessary aids are provided.
3. Candidates may use one of two calculators, the Casio or Sharp approved models.
4. There are three sections to this exam (Parts A, B and C). Answer all questions in Part A, 2 questions in Part B and 1 question in Part C.

## PART A:

- (5) 1. What are the advantages of dual media filtration with anthracite-sand to a mono-medium sand filter? For a dual media filter, explain why anthracite is often placed on top of sand. Provide a sketch of particle size versus depth for the mono-medium filter.
- (4) 2. How does the objective of a primary clarifier differ from the objective a secondary clarifier? Which clarifier would likely remove a higher concentration of BOD<sub>5</sub>? (4 marks)
- (10) 3. On the basis of disinfection capacity and disinfectant by-product formation, compare ozone, free chlorine and chlorine dioxide as possible disinfecting agents for water treatment. What are two important distinctions between disinfection with UV and disinfection with free chlorine? What is the difference between total and free chlorine.
- (8) 4. A town in Northern Ontario has two possible water sources for water treatment: a groundwater aquifer and a small lake. The groundwater aquifer has a pH of 8, a turbidity of 0.8 NTU, an average TOC of 1.5 mg/L, manganese of 0.4 mg/L<sup>1</sup> and an alkalinity of 100 mg/L as CaCO<sub>3</sub>. The reservoir has a pH of 5.6, a turbidity of 10 NTU, an average TOC of 8.0 mg/L, manganese of 0.03 mg/L and an alkalinity of 50 mg/L as CaCO<sub>3</sub>. Provide a preliminary process sketch of the treatment train for both water sources that indicates the important unit operations and *briefly* explain your rationale for selecting that process. In both designs describe what major driving forces are impacting your design decisions.
- (5) 5. Two activated sludge systems to have identical hydraulic retention times and MLVSS. One system has a sludge age that is exactly two times greater than the other system. All other things being equal determine which system will remove the most BOD<sub>5</sub>.

---

<sup>1</sup> Drinking water guideline for manganese is 0.05 mg/L.

**PART B:**

Answer 2 questions from this section.

- (25)
6. A water treatment plant is to process 30,000 m<sup>3</sup>/d of water. The rapid-mixing tank will blend 35 mg/L of ferric chloride and have a retention time of 2-min. The tank is designed such that water flows in from the bottom of the tank and overflows at the top. The coagulant is added in-line at the bottom of the tank. The tank is designed to have a square cross-section (i.e., L=W) with vertical baffles on the walls and a flat blade impeller system. The designed water temperature is 15°C. Determine:
- Quantity of ferric chloride used per month and the required natural alkalinity (in mg/L as CaCO<sub>3</sub>) to avoid a change in pH.
  - The dimensions of the tank given that the Re must be equal to or greater than 100,000. Provide a sketch of the tank with dimensions shown.
  - The power required to achieve a G-value of 950s<sup>-1</sup>.

- (25) 7. Shallow automatic backwash filters are to be used as the final process in a municipal wastewater treatment plant treating an average flow of  $0.75 \text{ m}^3/\text{s}$ . The average temperature of the wastewater is  $15^\circ\text{C}$ . For the filter properties given below, calculate the total filter surface area required if the maximum allowable head loss is  $0.2 \text{ m}$ . Assume a maximum friction factor of  $225$  and check that this assumption is not violated. Use the  $d_{60}$  particle size in the head loss calculations.

Filter Properties

- Filter depth =  $0.3 \text{ m}$
- Uniformity coefficient =  $1.4$
- Effective size =  $0.5 \text{ mm}$
- Sphericity =  $0.85$
- Porosity =  $0.4$
- Relative density =  $2.65$

- (25) 8. Design a horizontal clarifier to have a flow rate of 25,000 m<sup>3</sup>/d and an average retention time of 0.5 h. The tank should have a maximum effective depth of 4.5 m and a length to width ratio of 4:1. The average water temperature is 15°C.

A particle size analysis has been performed on the influent suspended solids (Table 1). For particles with a specific gravity of 2.5, determine the effluent TSS concentration from the clarifier and the overall removal efficiency.

**Table 1:** Influent Particle Size Analysis

Mean Particle Diameter, $\mu\text{m}$	Mass Concentration, mg/L
10	75
50	150
100	165
150	130

## PART C

Answer 1 question from this section

- (25) 9. A flocculation basin consists of two compartments with four parallel streams. The plant flow rate is  $20000 \text{ m}^3/\text{d}$  and the average water temperature is  $15 \text{ }^\circ\text{C}$ . Each horizontal paddle set in the floc basin has eight blades and two paddle arms (Figure 2). The blade width is  $10 \text{ cm}$  and its length is  $3.0 \text{ m}$ . The total paddle arm length is  $3.0 \text{ m}$ . At the ends of each paddle arm are two blades, which are spaced  $90 \text{ cm}$  apart. The paddles in the first compartment are rotating at a speed of  $5 \text{ rpm}$ . The rotational speed of the paddles in the second compartment is  $2.5 \text{ rpm}$ . Each compartment cell (i.e. compartment for each parallel stream) has a width and length of  $4 \text{ m}$ . The depth in the influent to the first compartment is  $4.0 \text{ m}$  and increases to  $4.5 \text{ m}$  at the effluent. The depth at the effluent of the second compartment is  $5.0 \text{ m}$ .
- a) How much power is dissipated into the water for each compartment?
- b) Determine the  $G \cdot t$  value for each compartment.

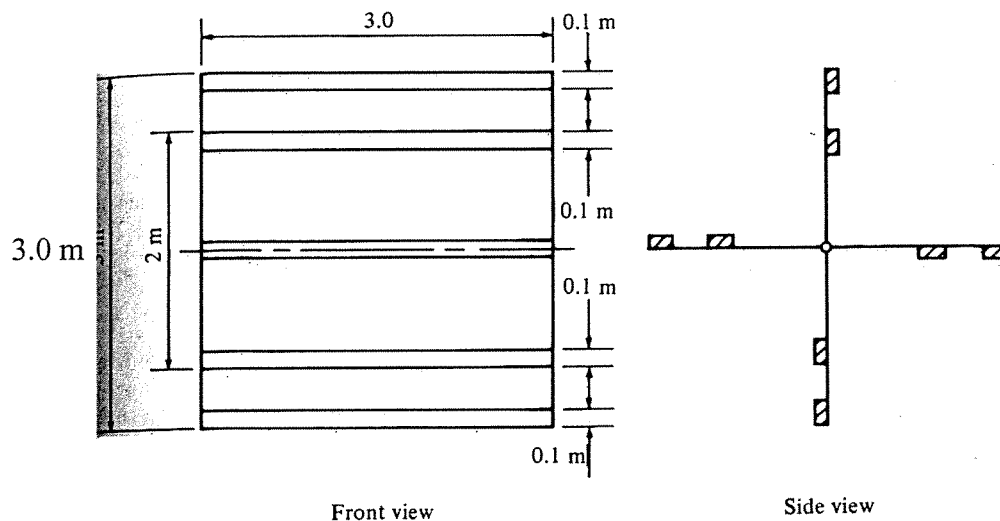


Figure 2: Flocculator design.

- (25) 10. An activated sludge system consists of 2 CSTRs in parallel for aeration and one secondary clarifier. Each aeration reactor has a surface area of  $196 \text{ m}^2$  and a depth of 6 m. The system must produce a soluble effluent  $\text{BOD}_5$  of  $15 \text{ mg/L}$  from a wastewater with a total volumetric flow rate of  $9400 \text{ m}^3/\text{d}$  and influent soluble  $\text{BOD}_5$  of  $270 \text{ mg/L}$ . The biomass recycle ratio is kept constant at 0.4 and the settling data for the total suspended solids are shown in Figure 1. The bio-kinetic properties are provided below. The effluent concentration of biomass from the secondary clarifier is  $0 \text{ mg/L}$ . The temperature of the wastewater is  $10^\circ\text{C}$ . For the conditions of this activated sludge system determine the solids retention time MLVSS and waste TSS concentration from the secondary clarifier.

Microbiological Characteristics (Temperature at  $20^\circ\text{C}$ )

$$Y = 0.46$$

$$k = 3.7 \text{ d}^{-1}$$

$$K_S = 80 \text{ mg/L}$$

$$k_d = 0.05 \text{ d}^{-1}$$

$$f = \text{VSS/TSS} = 0.9$$

$$X_{\text{influent}} = 0 \text{ mg/L}$$

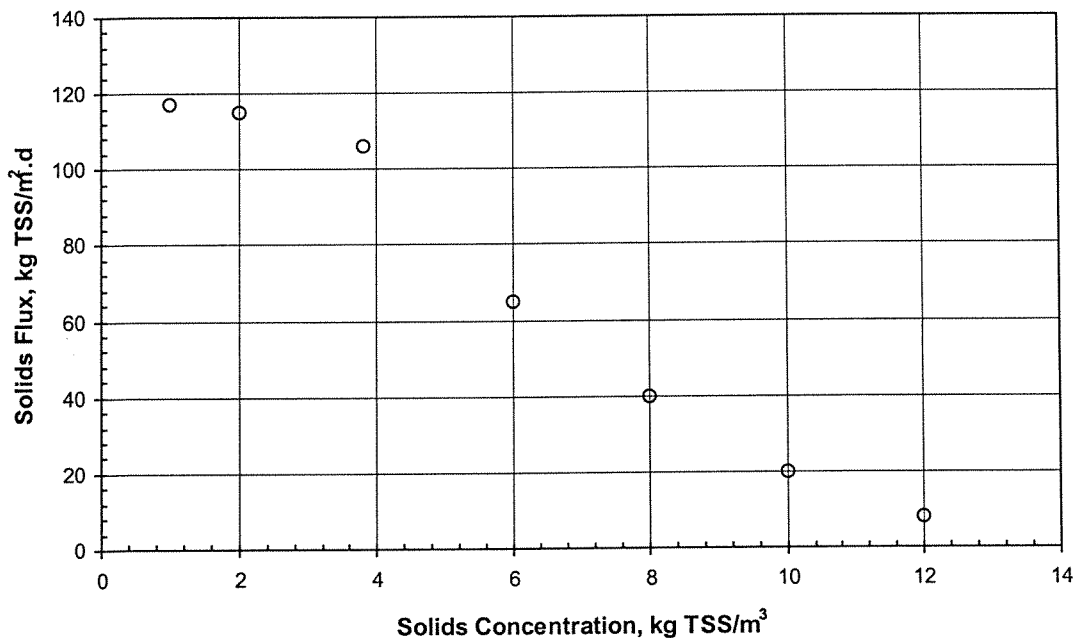


Figure 1: Settling data for secondary clarifier.

(25)

11. An industrial wastewater treatment facility has a daily flow of  $310 \text{ m}^3/\text{d}$  and a  $\text{BOD}_5$  of  $600 \text{ mg/L}$ . Because influent concentration of solids is very low, an extended aeration system is used to treat the waste. The average temperature of the waste is  $16^\circ\text{C}$ . City by-laws require that the effluent  $\text{BOD}_5$  must be less than  $50 \text{ mg/L}$  prior to discharging the waste into the municipal sewer system.

- a) Calculate the volume of the aeration reactor and the MLVSS.
- b) Given that the  $10 \text{ kW}$  mechanical aerators have standard oxygen transfer rate of  $1.25 \text{ kg O}_2/\text{kW.h}$ , determine the effluent DO concentration.

**Microbiological Properties (at  $20^\circ\text{C}$ )**

$$Y = 0.5$$

$$k = 4.5 \text{ d}^{-1}$$

$$K_S = 120 \text{ mg/L}$$

$$k_d = 0.04 \text{ d}^{-1}$$

Conversion factor ( $f$ ) for relating  $\text{BOD}_5$  to COD is  $0.68$ .

**Aeration Properties (at  $20^\circ\text{C}$ )**

$$\beta = 0.95$$

$$\alpha = 0.8$$

$$K_{La} = 0.90 \text{ h}^{-1}$$

## Formula Sheet

$$r = \frac{dC}{dt}$$

$$\theta = V/Q$$

$$\frac{A_c L}{Q} = \int_{c_o}^c \frac{dC}{r}$$

$$G = \sqrt{\frac{P}{\mu V}}$$

$$P = 1.44 \times 10^{-4} C_D \rho b [N(1-k)]^3 (r_o^4 - r_i^4)$$

$$k = 0.25 \text{ with stators}$$

$$k = 0.0 \text{ without stators}$$

$$C_D = 1.4$$

$$\% R_T = \frac{\Delta h_1}{h_T} \left( \frac{R_1 + R_2}{2} \right) + \frac{\Delta h_2}{h_T} \left( \frac{R_2 + R_3}{2} \right) + \dots \quad v'_c = \frac{Q}{nA_p \cos \theta}$$

$$X_r = (1 - X_c) + \int_0^{x_c} \frac{v}{v_c} dx$$

$$SF_T = SF_g + SF_u = C_i v_h + C_i U$$

$$A_s SF_L \geq Q C_o$$

$$h_L = f_f \frac{(1-e)}{e^3 \psi} \cdot \frac{v_s^2}{g} \cdot \frac{L}{d}$$

$$-r_A = \frac{Q}{A} (C_{o,A} - C_A)$$

$$C_n = \frac{C_o}{(1 + \tau k)^n}$$

$$v^2 = \frac{4}{3} \cdot \frac{g d}{C_D} \cdot \left( \frac{\rho_p - \rho}{\rho} \right)$$

$$\text{Re} < 1, C_D = \frac{24}{\text{Re}}$$

$$\text{Re} > 1, C_D = \frac{24}{\text{Re}} + \frac{3}{\sqrt{\text{Re}}} + 0.34$$

$$v_c = \frac{Q}{A_s}$$

$$R_H = \frac{A_x}{w_p}$$

$$\text{Re} = \frac{v d \rho}{\mu}$$

$$\text{Re} = \frac{v d \psi \rho}{\mu}$$

$$f_f = 150 \frac{1-e}{\text{Re}} + 1.75$$

## Formula Sheet

$$h_{L,i} = \frac{(1-e)}{e^3 \psi} \cdot \frac{v_S^2}{g} \cdot L \sum \left( f f_i \frac{x_i}{d_i} \right)$$

$$h_{L,i} = \frac{(1-e)}{e^3 \psi} \cdot \frac{v_S^2}{g} \cdot L \sum \left( f f_i \frac{x_i}{d_i} \right)$$

$$d_{60} = U d_{10} \quad d_{90} = d_{10} U^{1.67}$$

$$d_{60} = U d_{10} \quad d_{90} = d_{10} U^{1.67}$$

$$\text{Re}_{mf} = \frac{v_{mf} d_{90} \rho}{\mu}$$

$$\text{Re}_{mf} = \frac{v_{mf} d_{90} \rho}{\mu}$$

$$\text{Ga} = \frac{d_{90}^3 \rho (\rho_s - \rho) g}{\mu^2}$$

$$\text{Ga} = \frac{d_{90}^3 \rho (\rho_s - \rho) g}{\mu^2}$$

$$\text{Re}_{mf} = [33.7^2 + 0.0408 \text{Ga}]^{0.5} - 33.7$$

$$\ln \frac{N}{N_o} = -\alpha C^n t$$

$$r_s = \frac{-k X S}{K_s + S}$$

$$r'_g = -Y r_s - k_d X$$

$$\theta_x = \frac{X_v V}{(Q - Q_w) X_{ve} + Q_w X_{vr}}$$

$$k_T = k_{20} 1.04^{T-20}$$

$$\frac{1}{\theta_x} = \frac{Y(S_o - S)}{X_v \theta} - k_d$$

$$\frac{1}{\theta^m} = \frac{Y k S_o}{K_s + S_o} - k_d$$

$$P_X = Y_{obs} Q (S_o - S)$$

$$Y_{obs} = \frac{Y}{1 + k_d \theta_x}$$

$$F/M = \frac{S_o}{\theta X_v}$$

$$r = \frac{1 - \frac{\theta}{\theta_x}}{\frac{X_{vr}}{X_v} - 1}$$

$$r_{gas} = K_L a (C_s - C)$$

$$C = C_s - (C_s - C) \cdot \exp(-K_L a t)$$

$$N = N_o \left( \frac{\beta C_s - C}{9.09} \right) \alpha 1.024^{T-20}$$

$$P_R = \frac{O_{2R}}{N \cdot 24}$$

$$H = \frac{p_g}{C_l} \quad H' = \frac{C_g}{C_l}$$

$$H' = \frac{H}{RT}$$

$$(K_L a)_{VOC} = \psi (K_L a)_{O_2}$$

$$O_{2R} = \frac{Q(S_o - S)}{f} - 1.42 P_x$$

### Formula Sheet

$$E = Q_g H' C_l (1 - e^{-\phi})$$

$$E = Q_g H' C_l (1 - e^{-\phi})$$

$$\phi = \frac{(K_L a)_{VOC} V}{H' Q_g}$$

$$\phi = \frac{(K_L a)_{VOC} V}{H' Q_g}$$

$$(K_L a)_T = (K_L a)_{20} 1.024^{(T-20)}$$

$$(K_L a)_T = (K_L a)_{20} 1.024^{(T-20)}$$

$$R = 0.0821 \frac{L \cdot atm}{mol \cdot K}$$

$$R = 0.0821 \frac{L \cdot atm}{mol \cdot K}$$

$$Q_{O_2} = \frac{O_{2R}}{E} \cdot 0.7$$

$$Q_a = \frac{Q_{O_2}}{0.21} \times \frac{273 + T}{273}$$

**Table C.1 Physical properties of water in SI units**

Temp, °C	Specific weight $\gamma$ , N/m <sup>3</sup>	Density $\rho$ , kg/m <sup>3</sup>	Viscosity $\mu \times 10^3$ , N · s/m <sup>2</sup>	Kinematic viscosity $\nu \times 10^6$ , m <sup>2</sup> /s	Surface tension $\sigma \times 10^2$ , N/m	Vapor- pressure head $p_v/\gamma$ , † m	Bulk modulus of elasticity $K \times 10^{-7}$ , N/m <sup>2</sup>
0	9806	999.9	1.792	1.792	7.62	0.06	204
5	9807	1000.0	1.519	1.519	7.54	0.09	206
10	9804	999.7	1.308	1.308	7.48	0.12	211
15	9798	999.1	1.140	1.141	7.41	0.17	214
20	9789	998.2	1.005	1.007	7.36	0.25	220
25	9778	997.1	0.894	0.897	7.26	0.33	222
30	9764	995.7	0.801	0.804	7.18	0.44	223
35	9749	994.1	0.723	0.727	7.10	0.58	224
40	9730	992.2	0.656	0.661	7.01	0.76	227
45	9711	990.2	0.599	0.605	6.92	0.98	229
50	9690	988.1	0.549	0.556	6.82	1.26	230
55	9666	985.7	0.506	0.513	6.74	1.61	231
60	9642	983.2	0.469	0.477	6.68	2.03	228
65	9616	980.6	0.436	0.444	6.58	2.56	226
70	9589	977.8	0.406	0.415	6.50	3.20	225
75	9560	974.9	0.380	0.390	6.40	3.96	223
80	9530	971.8	0.357	0.367	6.30	4.86	221
85	9499	968.6	0.336	0.347	6.20	5.93	217
90	9466	965.3	0.317	0.328	6.12	7.18	216
95	9433	961.9	0.299	0.311	6.02	8.62	211
100	9399	958.4	0.284	0.296	5.94	10.33	207

†  $\gamma = 9806 \text{ N/m}^3$ .